
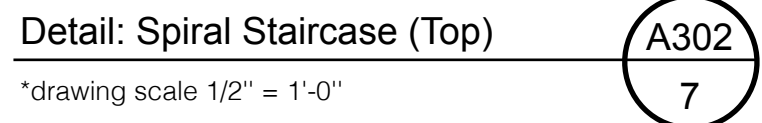


1. Unless labelled as "existing", assume features are to be newly constructed. (Refer to foundation and roof plans for the general boundaries of what is existing and what is to be newly constructed.)
2. Exterior elevations are with respect to bottom edge of wood siding. This point is approximately 6" above grade.

"Special stairways shall follow all requirements of the code with the following exceptions:

- Treads at a wider stairways shall have a minimum depth of 10" at a point measured 12" along the nosing edge from the side where the treads are narrower.
- The largest tread depth shall not exceed the smallest tread depth by more than 3/8".
- Treads shall have a minimum depth of 6" at any point within the clear width of the stairs."







- Minimum 4'-4" clear width at and below the handrail.
- Tread depth:
 - 10" at 12" from narrower edge.
 - All tread depths are identical.
- Riser height: 7 1/8"
- Headroom: 9'-7 1/8"

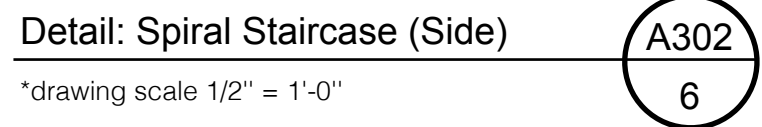

 wood framing

 concrete

[WD---] Window or Door labels are attached to window/door *width*. Note that width indicates the *rough opening*. See schedules on page A601.

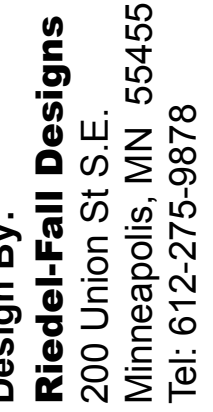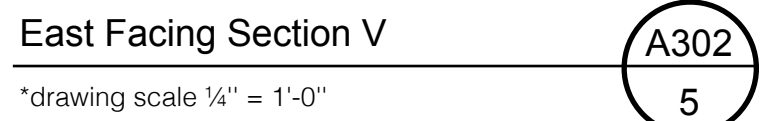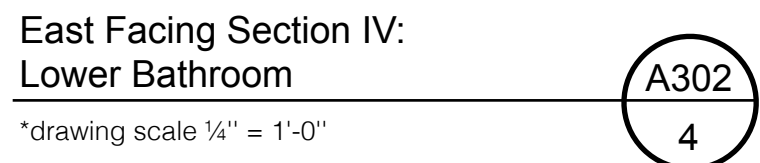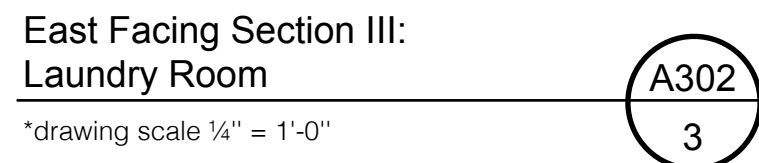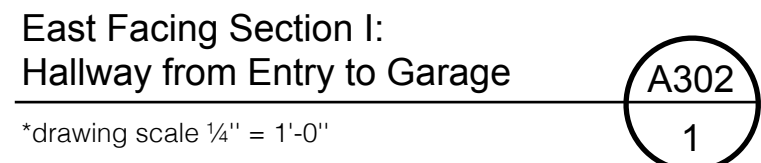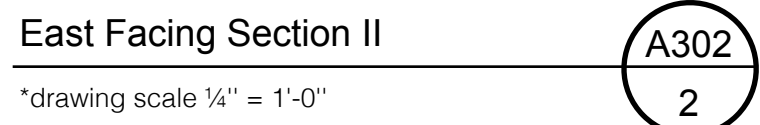

Dr. Marc Riedel & Ms. Emery Fall
5995 Ridge Rd.
Shorewood, MN 55331
Tel: 612-275-9878

Date	Revision	By
9/11/17	Initial Drawings	MDR, EKF
11/29/17	Attium, Entry	MDR, EKF
5/7/18	Skylights, Foundations	MDR, EKF
7/3/18	Brick Entry	MDR, EKF
10/3/18	Revised Windows	MDR, EKF
1/14/19	Permit	MDR, EKF

DATE SUBMITTED
01.14.19

DRAWN BY
MDR, EKF

A302 East-Facing Sections; Staircase Details

A302